

INTEGRATED LED AC + EMERGENCY DRIVER


184501

A1

FEATURES



1. For normal and emergency operation of LEDs, no need an extra LED driver
2. AC driver function in normal mode: constant current and multi-current selectable output, 0-10V dimmable
3. Four emergency output powers selectable
4. Auto Test
5. Slim aluminium housing
6. Suitable for indoor, dry and damp applications

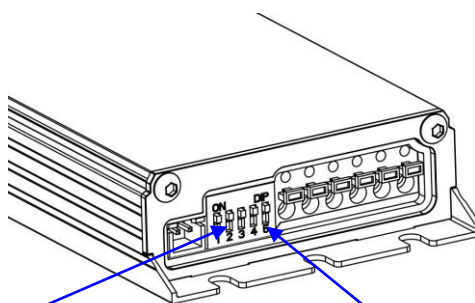

Dipswitch 1/2/3: Setting LED working current in normal mode


Dipswitch 4/5: Setting emergency output

Driver Current Selection				Emergency Output Selection			
Dipswitch			SEC	Dipswitch		Power	Battery
1	2	3		4	5		
—	—	—	600mA (18-60V)	—	—	25% (3.5W)	9.6V/1Ah
ON	—	—	700mA (18-60V)	ON	—	50% (7W)	9.6V/2Ah
—	ON	—	750mA (18-56V)	—	ON	75% (14W)	9.6V/4Ah
—	—	ON	800mA (18-52V)	ON	ON	100% (17W)	9.6V/5Ah
ON	ON	—	850mA (18-49V)	Max. emergency output power 17W			
ON	—	ON	900mA (18-46V)				
—	ON	ON	950mA (18-44V)				
ON	ON	ON	1000mA (18-42V)				

CHARACTERISTICS


Type	184501			
Model	184501-A1-8C1.0	184501-A1-8C2.0	184501-A1-8C4.0	184501-A1-8C5.0
Rated voltage	120-277VAC 50/60Hz			
Rated current	0.5A			
Rated power	59W			
Emergency output power	25% (3.5W)	50% (7W)	75% (14W)	100% (17W)
Output voltage	18-60VDC			
Operation frequency	320kHz \geq f \geq 50kHz			
Power factor	0.9			
Battery	Ni-Cd/Ni-MH/LiFePO4/Li-ion			
Charging time	24 Hours			
Discharge time	>90 Minutes			
Charging current	0.05-0.25A			
Life time	5 years			
Charging cycles	>500			
Operation temperature	0-50°C (32°F-122°F)			
Output current	600mA, 700mA, 750mA, 800mA, 850mA, 900mA, 950mA, 1000mA \pm 5%			
Efficiency	75%			
Abnormal protection	Inrush, over voltage, charging and discharging, open circuit , short circuit protection with auto reset			
Wire	0.75-1.5mm ²			
EMC/FCC/IC standard	EN 55015, EN 61547, EN 61000-3-2, EN 61000-3-3, FCC part 15, ICES-005			
Safety standard	EN 61347-1, EN 61347-2-7, EN 61347-2-13, UL924, CSA C.22.2 No. 141			
Meas. Module mm [inch]	L195 [7.68] x W65 [2.56] x H22 [0.87] Mounting Center: 187 [7.36]			
Meas. Battery pack mm [inch]	9.6V 1.0Ah: L228 [8.98] x W30 [1.18] x H17 [0.67] Mounting Center: 217 [8.54] 9.6V 1.5/2.0Ah: L195 [7.68] x W45.5 [1.79] x H24.5 [0.96] Mounting Center: 184 [7.24] 9.6V 4.0Ah: L263 [10.35] x W65 [2.56] x H35 [1.38] Mounting Center: 252 [9.92]			

MODULE DIMENSIONS

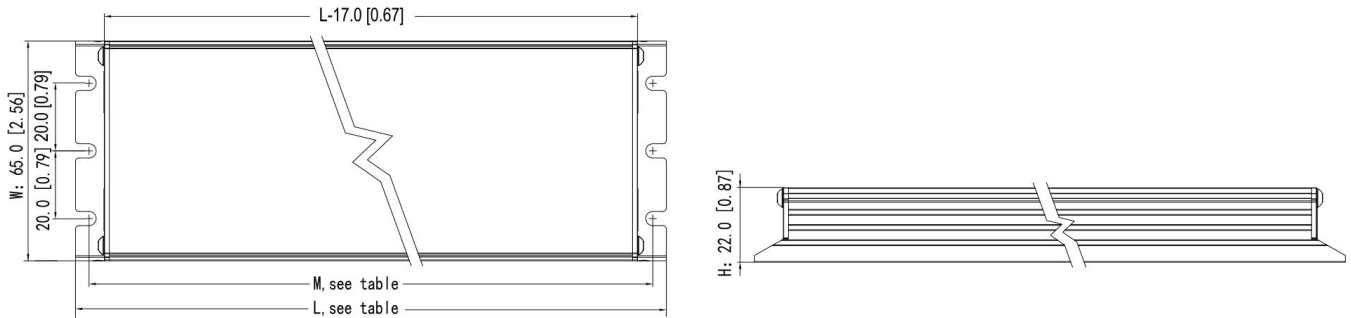

Item No.	L mm [inch]	M mm [inch]	W mm [inch]	H mm [inch]
184501	195 [7.68]	187 [7.36]	65 [2.56]	22 [0.87]


BATTERY

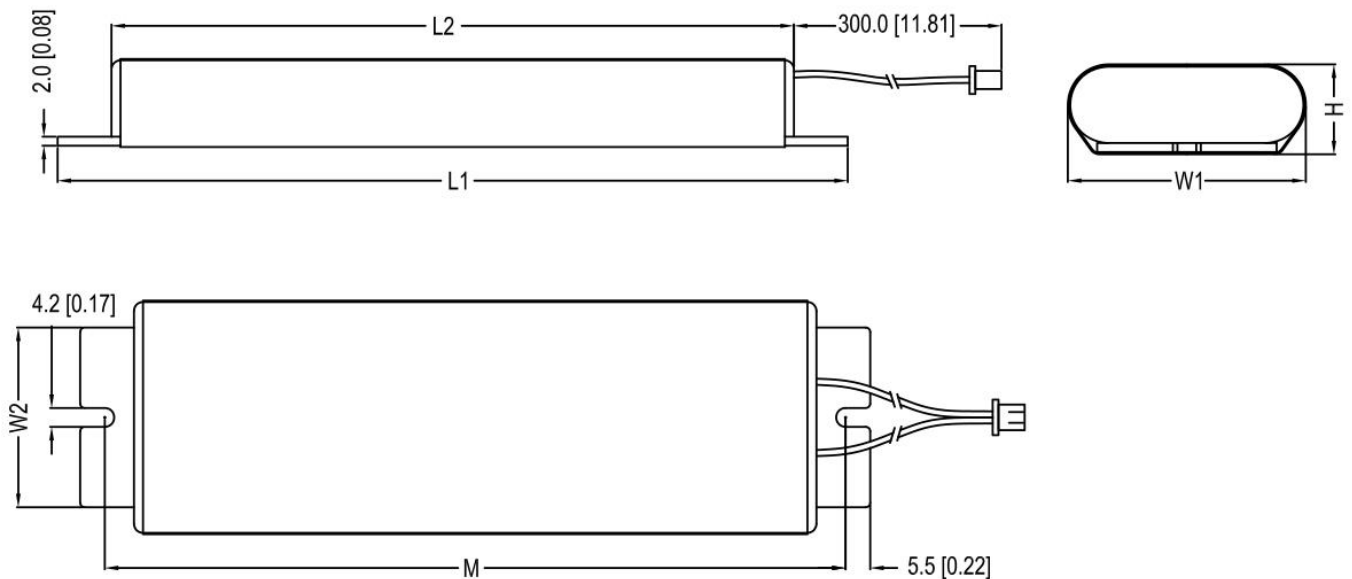

Battery model	Spec.	L1 mm [inch]	L2 mm [inch]	M mm [inch]	W1 mm [inch]	W2 mm [inch]	H mm [inch]
BP-CD-8C1.0	9.6V 1.0AH	228 [8.98]	195 [7.68]	217 [8.54]	30 [1.18]	20 [0.79]	17 [0.67]
BP-CD-8C2.0	9.6V 2.0AH	195 [7.68]	170 [6.69]	184 [7.24]	45.5 [1.79]	40 [1.57]	24.5 [0.96]
BP-CD-8C4.0	9.6V 4.0AH	263 [10.35]	236 [9.29]	252 [9.92]	65 [2.56]	40 [1.57]	35 [1.38]
BP-CD-8C5.0	9.6V 5.0AH	263 [10.35]	236 [9.29]	252 [9.92]	65 [2.56]	40 [1.57]	35 [1.38]

MODULE DIMENSIONS


LED TEST SWITCH (LTS)

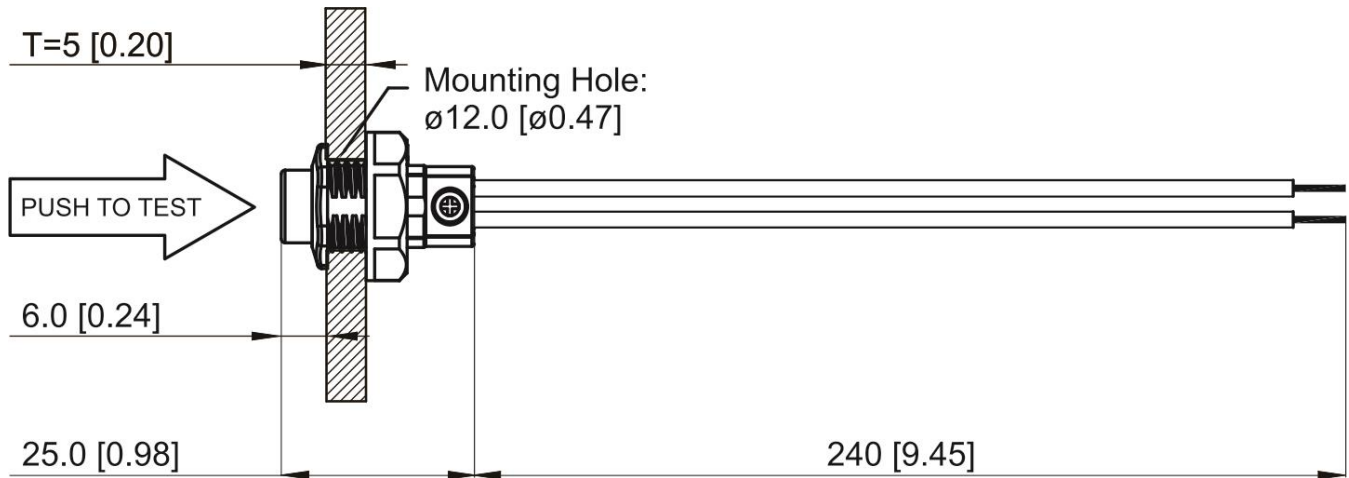

Dimension unit: mm [inch]

Tolerance: ± 1 [0.04]

WIRING DIAGRAMS

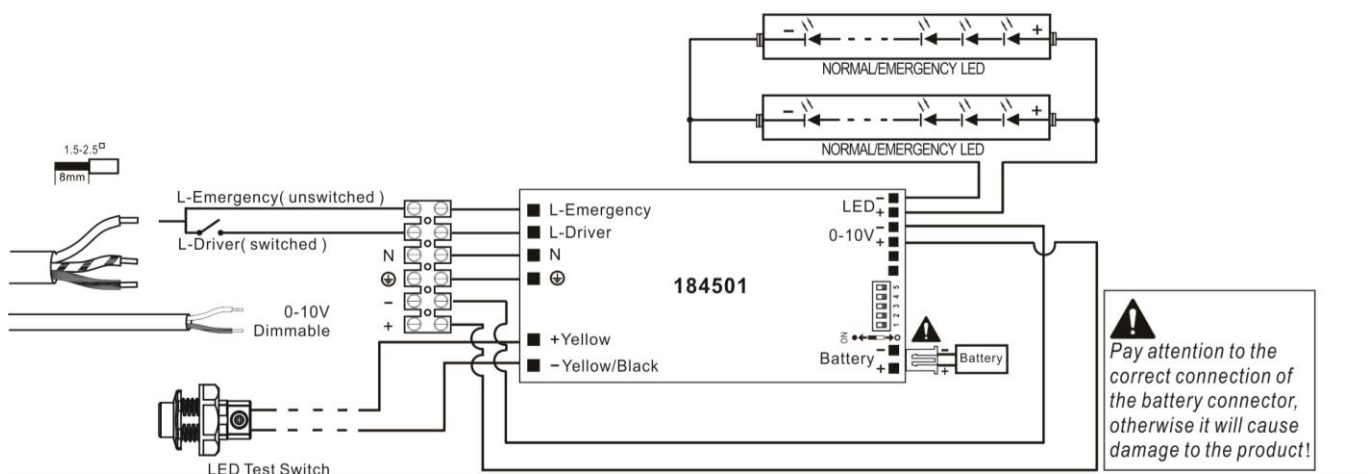

OPERATION/TESTING/MAINTENANCE

OPERATION

When AC power is applied, the LED test switch is illuminated, indicating that the batteries are being charged. When AC power fails, the 184501 automatically switches to emergency power, operating the lighting load at rated emergency power. During power failure, the LED test switch will be off. When the AC power is restored, the emergency 184501 switches the system back to normal mode of operation and resumes battery charging. The charging time for a full discharge is 24 hours. A short term discharge test may be conducted after the 184501 has been charging for 1 hour. Charge for 24 hours before conducting a long term discharge test.

TESTING AND MAINTENANCE

The following Periodic testing is recommended to ensure the system is working correctly.

1. Visually inspect the LED test switch (LTS) monthly. It should be illuminated when AC power is applied.
2. Conduct a 30-second discharge test by switching off the emergency breaker every month. The LTS will be off.
3. Conduct a 90-minute discharge test once per year.

AUTO TEST

The 184501 has an Auto Test feature which saves cost by reducing the need for manual testing.

1. Initial Auto Test

When the system is connected properly and powered on, the 184501 will perform an initial Auto Test. If any abnormal conditions exist, the LTS will blink quickly. Once the abnormal condition is corrected, the LTS will function correctly.

2. Preprogrammed Scheduled Auto Test

- a) The unit will conduct the first Monthly Auto Test after 24 hours and up to 7 days after initial power on. Then monthly tests will be performed every 30 days.

- b) Annual Auto test will occur every 52 weeks after initial power on.

- Monthly Auto Test

The Monthly Auto Test shall be executed every 30 days, and will test; Normal to emergency transfer function, emergency, charging and discharging conditions are normal. Monthly test time is approximately 30 seconds.

- Annual Auto Test

Annual Auto Test will occur every 52 weeks after the initial 24 hours full charge, and will test; Proper initial battery voltage, 90-minute emergency operation and acceptable battery voltage at the end of the full discharge. If the Auto Test is interrupted by a power failure, a full 90-minute Auto Test will occur again 24 hours after the power is restored. If the power failure causes the battery to fully discharge, the product will restart the Initial Auto Test and Preprogrammed Scheduled Auto Test.

MANUAL TEST

- Press the LTS one time to simulate emergency mode.
- Press the LTS 2 times continuously within 3 seconds to force a monthly test. After the test is completed, the next (30-day) monthly test will count from this date.
- Press the LTS 3 times continuously within 3 seconds to force a 90-minute annual test. After the test is completed, the next (52-week) annual test will count from this date.
- During any manual test, press and hold the LTS for greater than 3 seconds to terminate a manual test. The Preprogrammed Scheduled Auto Test time will not change.

LED TEST SWITCH CONDITIONS

- LTS Slow Blinking: Normal Charging
- LTS On: Battery Fully Charged - Normal Condition
- LTS Off: Power Failure
- LTS Gradual Change: In Testing Mode
- LTS Quickly Blinking: Abnormal Condition - Corrective Action Required

SAFETY INSTRUCTIONS

1. To prevent electric shock, switch off the mains power supply until installation is complete and AC power is supplied to this product.
2. This product requires an un-switched AC power supply of 120-277V, 50/60Hz.
3. Make sure all connections are in accordance with the National or Canadian Electrical code and any local regulations.
4. To reduce the risk of electrical shock, disconnect both normal and emergency power supplies and connector of this product before servicing.
5. The product can operate with most LED lamps. For normal operation and emergency operation of LEDs, no need an extra LED driver. The emergency power and time are selectable.
6. This product is suitable for use in dry or damp locations. Do not mount it near gas, heaters, air outlets or other hazardous locations.
7. Use this product in 0°C minimum, 50°C maximum ambient temperatures.
8. Use caution when servicing batteries. Do not attempt to dismantle the batteries. Batteries' acid can cause burns to skin and eyes. If acid is spilled on skin or in eyes, flush acid with fresh water and contact a physician immediately.
9. As this product contains batteries, please be sure to store it in an indoor environment between -20°C ~ +30°C. It must be fully charged and discharged every 6 months from the date of purchase until it is officially put into use, then recharged 30-50% and stored for another 6 months, and so on. If the battery is not used for more than 6 months, it may cause excessive self-discharge of the battery, and the resulting reduction of battery capacity is irreversible. For products with separate battery and emergency module, please disconnect the connection between battery and module for storage. Due to its chemical properties, it is a normal situation for the battery capacity to decline naturally during use. Users should take this into account when choosing products.
10. The use of accessories equipment not recommended by the manufacturer may cause an unsafe condition.
11. Do not use this product for other than intended use.
12. The product should be mounted at locations and at heights where it will not be easily accessible to unauthorized personnel.
13. Installation and servicing should be performed by qualified personnel.
14. Ensure product compatibility before final installation. Make sure the polarity is correct when connecting the batteries. Wiring should be strictly in accordance with the wiring diagram, wiring errors will damage the product. A case of safety accident or product failure caused by users' illegal operation does not belong to the scope of customer complaint acceptance, compensation or product quality assurance.